


COMPACTION TEST REPORT

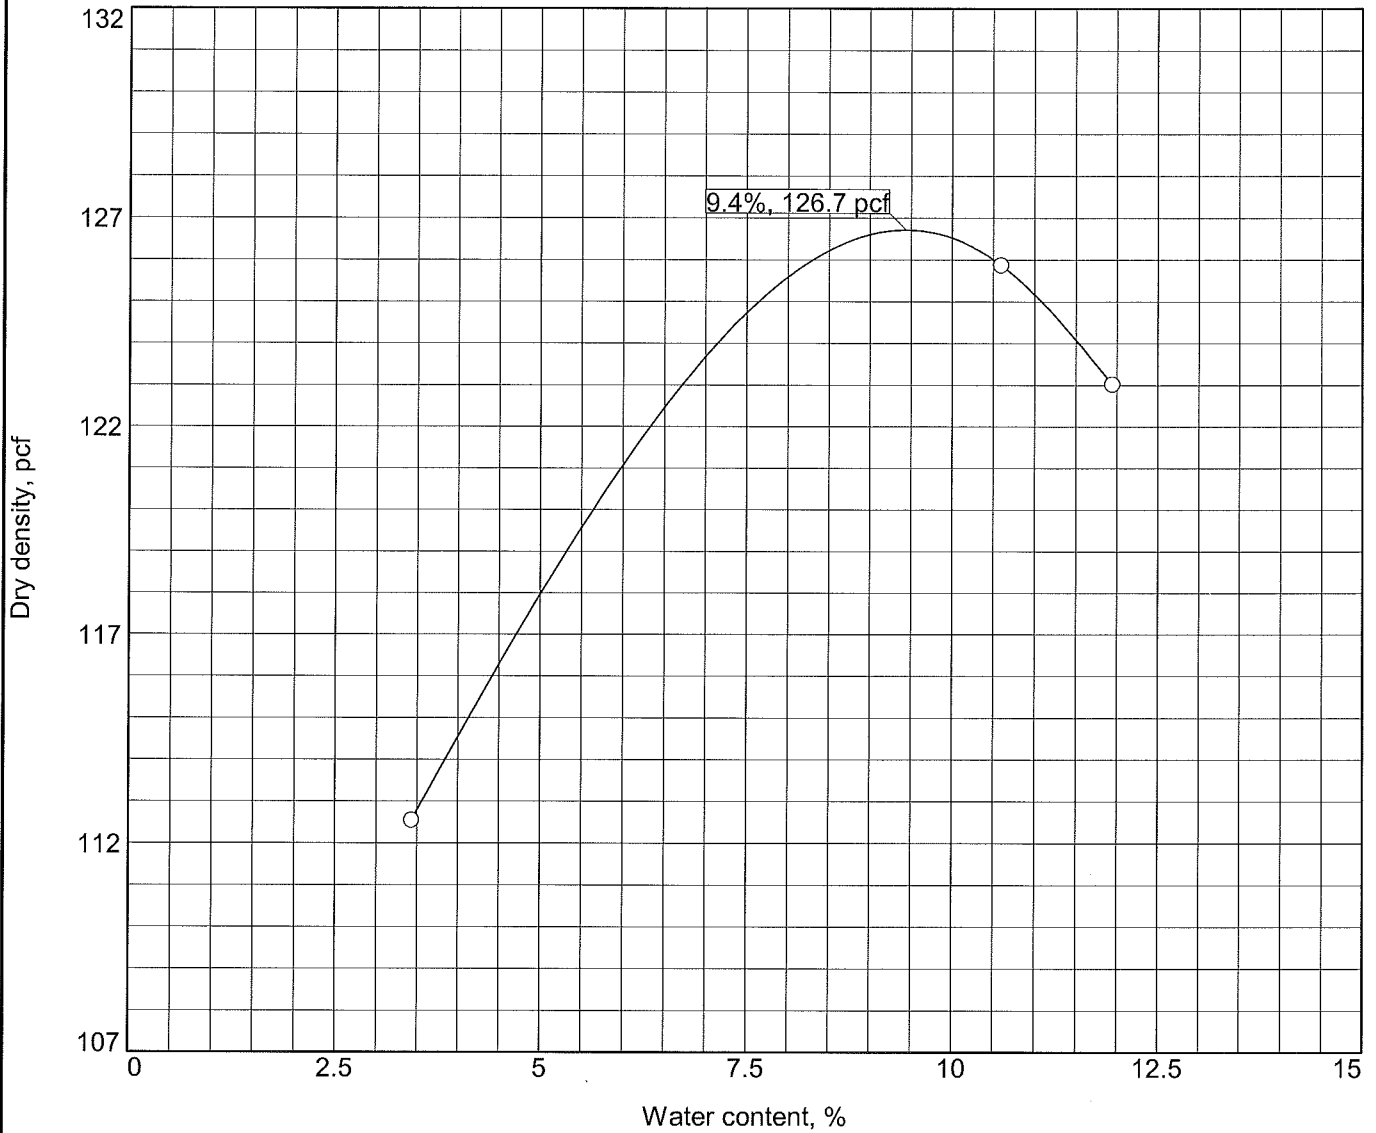

Test specification: ASTM D 1557-91 Procedure B Modified

Elev/ Depth	Classification		Nat. Moist.	Sp.G.	LL	PI	% > 3/8 in.	% < No.200
	USCS	AASHTO						

TEST RESULTS	MATERIAL DESCRIPTION
Maximum dry density = 126.7 pcf Optimum moisture = 9.4 %	Brown to Yellowish Brown CLAY, Silty with some fine gravel
Project No. P-7147 Client: Lawrence B. Karp Consulting Engineer Project: Sinai Temple Chapel and School Oakland, California ○ Location: Native Sample Number: Bulk Sample	Remarks:
Alan Kropp & Associates, Inc. 2140 Shattuck Avenue, Suite 910 Berkeley, CA	

Figure Curve No. 1